



ION Array Installation Guide

Table of Contents


ION Array Overview	3
Part Number Scheme	4
ION Array Installation	5
ION Array Electrical Information	5
ION - G2534** Drawings	6
ION - G0712** Drawings	9
Array Wiring	12

ION Array Overview

Designed to be installed in ductwork or air handling units and to actively clean air and provide a dry contact closure letting you know that the air is being cleaned. Arrays can be sized for almost any size ductwork and range from 1,000 CFM – 100,000 CFM. A predetermined slot is cut into the side of the ductwork. The array is slid into the ductwork and fastened into place. Power is connected to the control panel and if you desire feedback on operation you can bring the signal back to any building management system.

iAIRE has designed several predetermined CFM and array sizes, but any size and CFM combination can probably be achieved by contacting the factory. As with the standard ionization product, please make sure you inform us if this device is used in a smoking or kitchen environment so that the amount of ionization can be properly sized. If you are in a standard indoor air environment (no smoking or not a kitchen where there is fried foods), you would size each ionization block to do 2,000 CFM/block. If you are in a smoking or a kitchen environment, each ionization block will only do 1,000 CFM/block.

Ionization Array Part Number Scheme

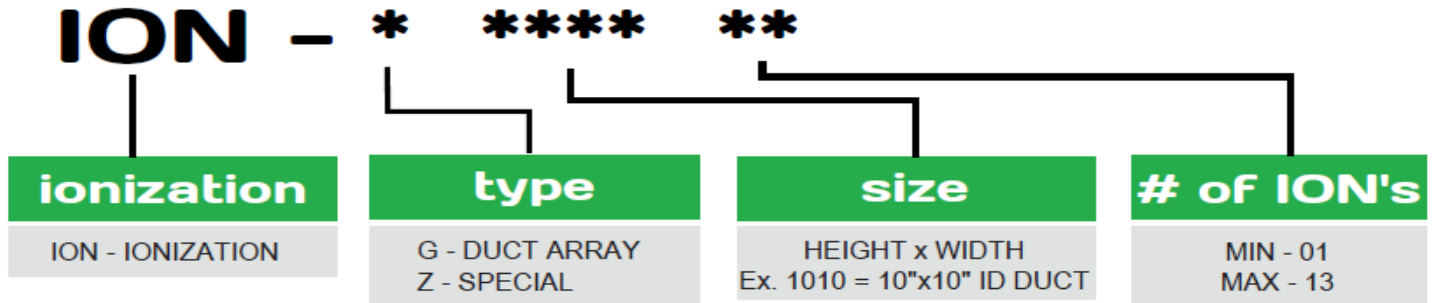

ION Array Installation

The ion array is designed to be installed in HVAC ductwork. A rectangular hole is cut into the side of the ductwork based on the size of the array. See submittal for the whole opening size to cut. Make sure the array will fit into the ductwork prior to cutting the whole. Once the whole is cut, the array can be inserted into the opening of the duct.

The array is expandable to fill the entire width of the ductwork. Prior to inserting the array in the duct, stretch out the array to the width of the duct and lock the array width. Take the cover off the control panel. Insert the array in rectangular opening in the duct. The array should be installed so the brush tips on the ion blocks are pointing slightly down. This will help prevent the ion blocks from building up as much carbon on the tips and help extend the life of the blocks. The blocks have a 2-year warranty from date of shipment. On the back of the control panel is gasketing. This will prevent moisture from being able to get into the duct or the control box once it is mounted. Make sure this gasketing shows no sign of damage. The array has been provided with a kit of self-tapping screws. Inside the control panel are a series of pre-drilled holes to allow for the array to be screwed to the side of the ductwork. Utilize these self-tapping screws to fasten the array to the side of the duct.

There are (2) knockouts cut in the side of the control panel. One of the knockouts is to bring high voltage power to the array. The 2nd is to bring in the control wire if you want the feedback that the array is working from the dry contact closure. See electrical information and wiring schematic for electric installation. The ion array is equipped with a multi-tap transformer that allows every array to be either 115/208/230/460 V. Make sure the correct voltage is wired. Once the power is hooked up to the array, the cover can be put back on the control panel and power turned on to the array.

ION Array Electrical Information

Every ion array is equipped with 24V ion devices. These ion devices wire into a step-down transformer. The transformer is a multi-tap transformer so that the array can be set up to run 115/208/230/460 V. This allows each array to be used in any voltage application by just switching the incoming power wires to the correct wires on the multi-tap transformer and the array will work. Each 24V ion block uses 4.3 Watts of power. You can determine the total amount of power consumed by the array by utilizing the following:

of ion blocks * 4.3 W = Total ion block Watts


Amperage = Total ion block Watts / Voltage

If there are 10 ion blocks there would be 43 Watts

If your power is 208 V then your amperage would be

$43 / 208 = 0.21$ amps

ION - G253413 Submittal Info

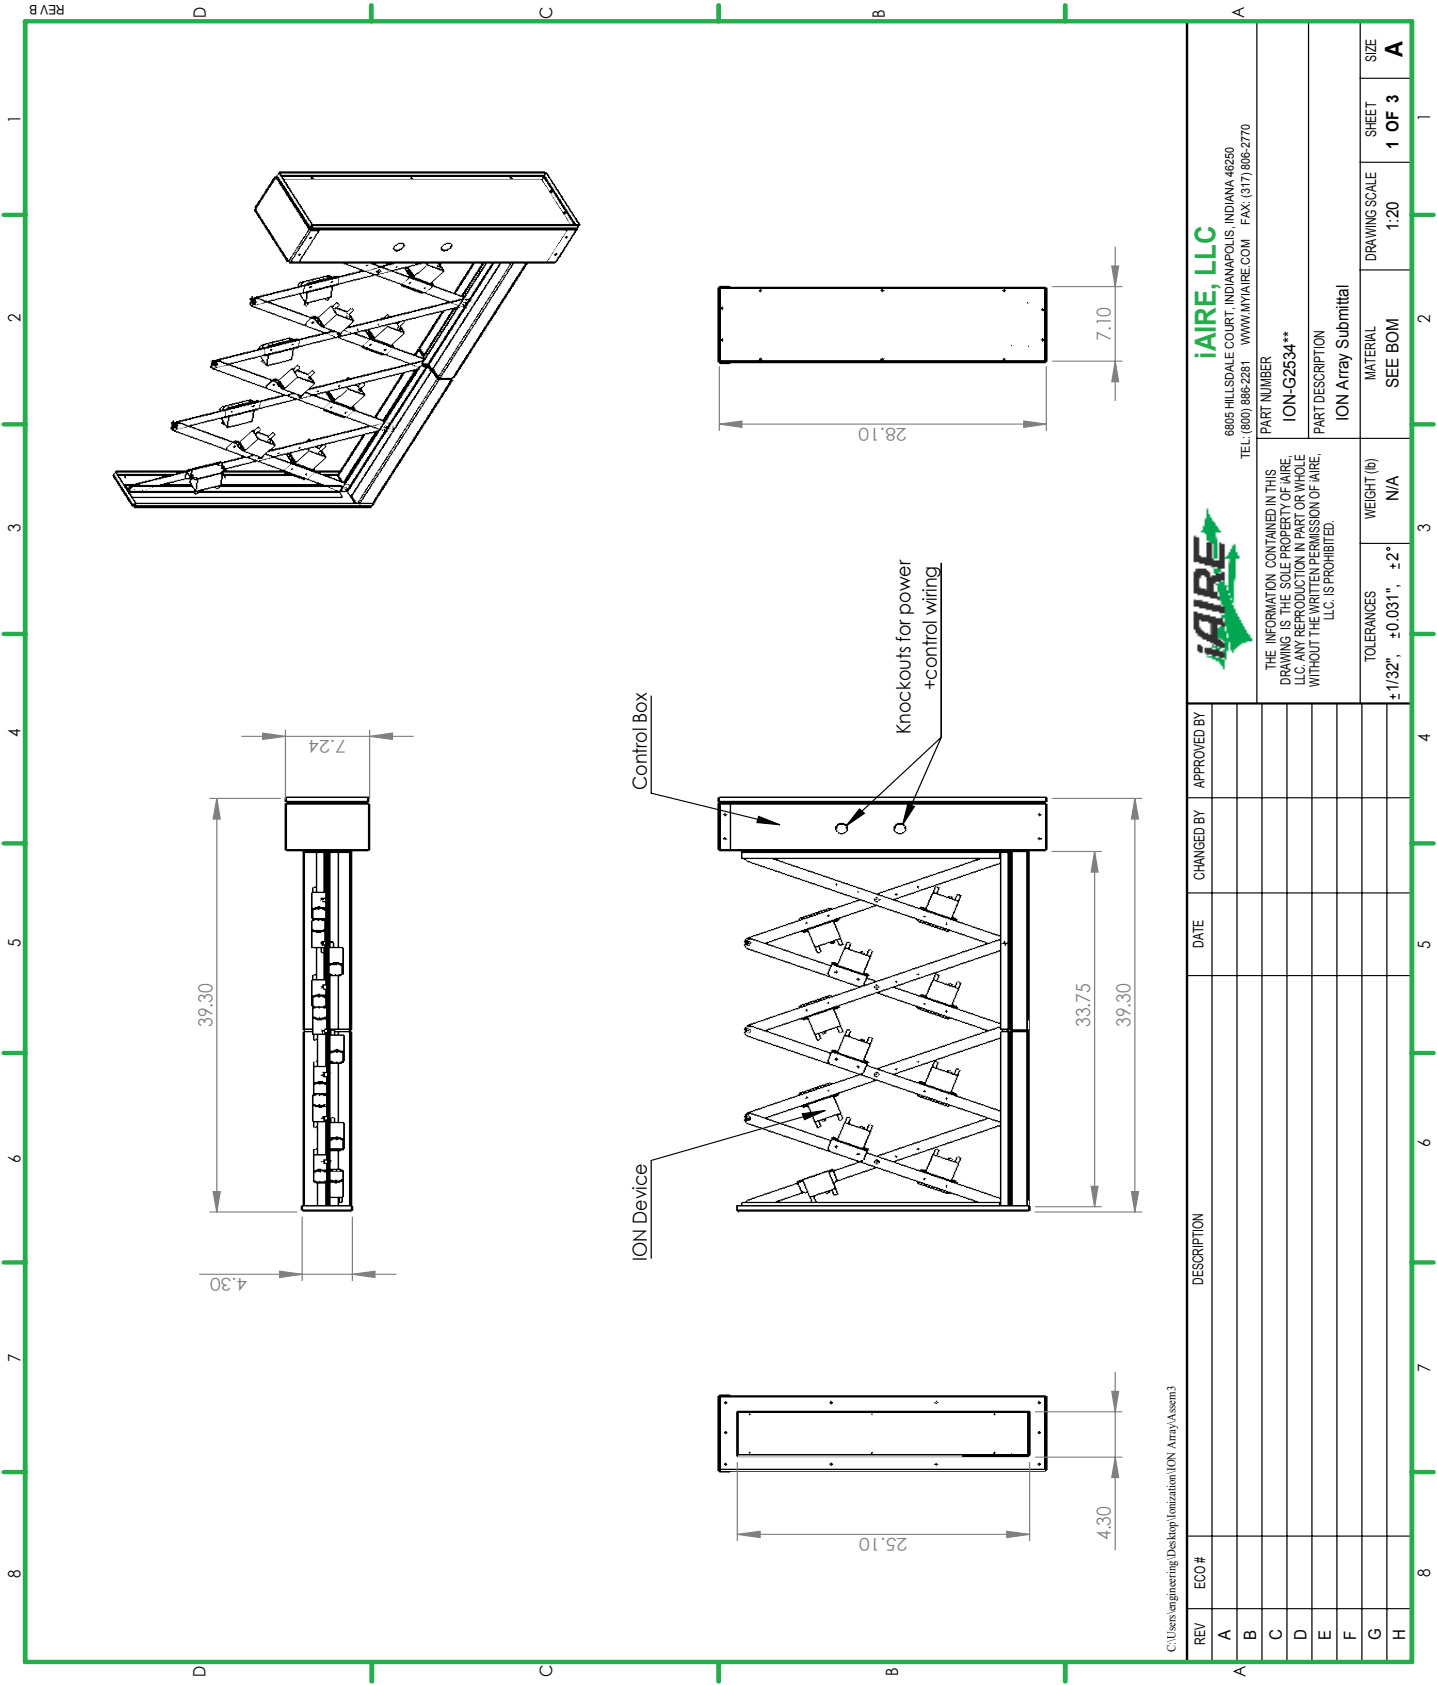


iAIRE, LLC
 6805 HILLDALE COURT, INDIANAPOLIS, INDIANA 46250
 TEL: (800) 886-2381 WWW.IAIRE.COM FAX: (317) 886-2770

PART NUMBER: ION-G2534**
 PART DESCRIPTION: ION Array Submittal

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF IAIRE, LLC. ANY REPRODUCTION IN PART OR WHOLE WITHOUT THE WRITTEN PERMISSION OF IAIRE, LLC IS PROHIBITED.


TOLERANCES	WEIGHT (lb)	MATERIAL	DRAWING SCALE	SHEET	SIZE
±1/32", ±0.031", ±2°	N/A	SEE BOM	1:20	1 OF 3	A

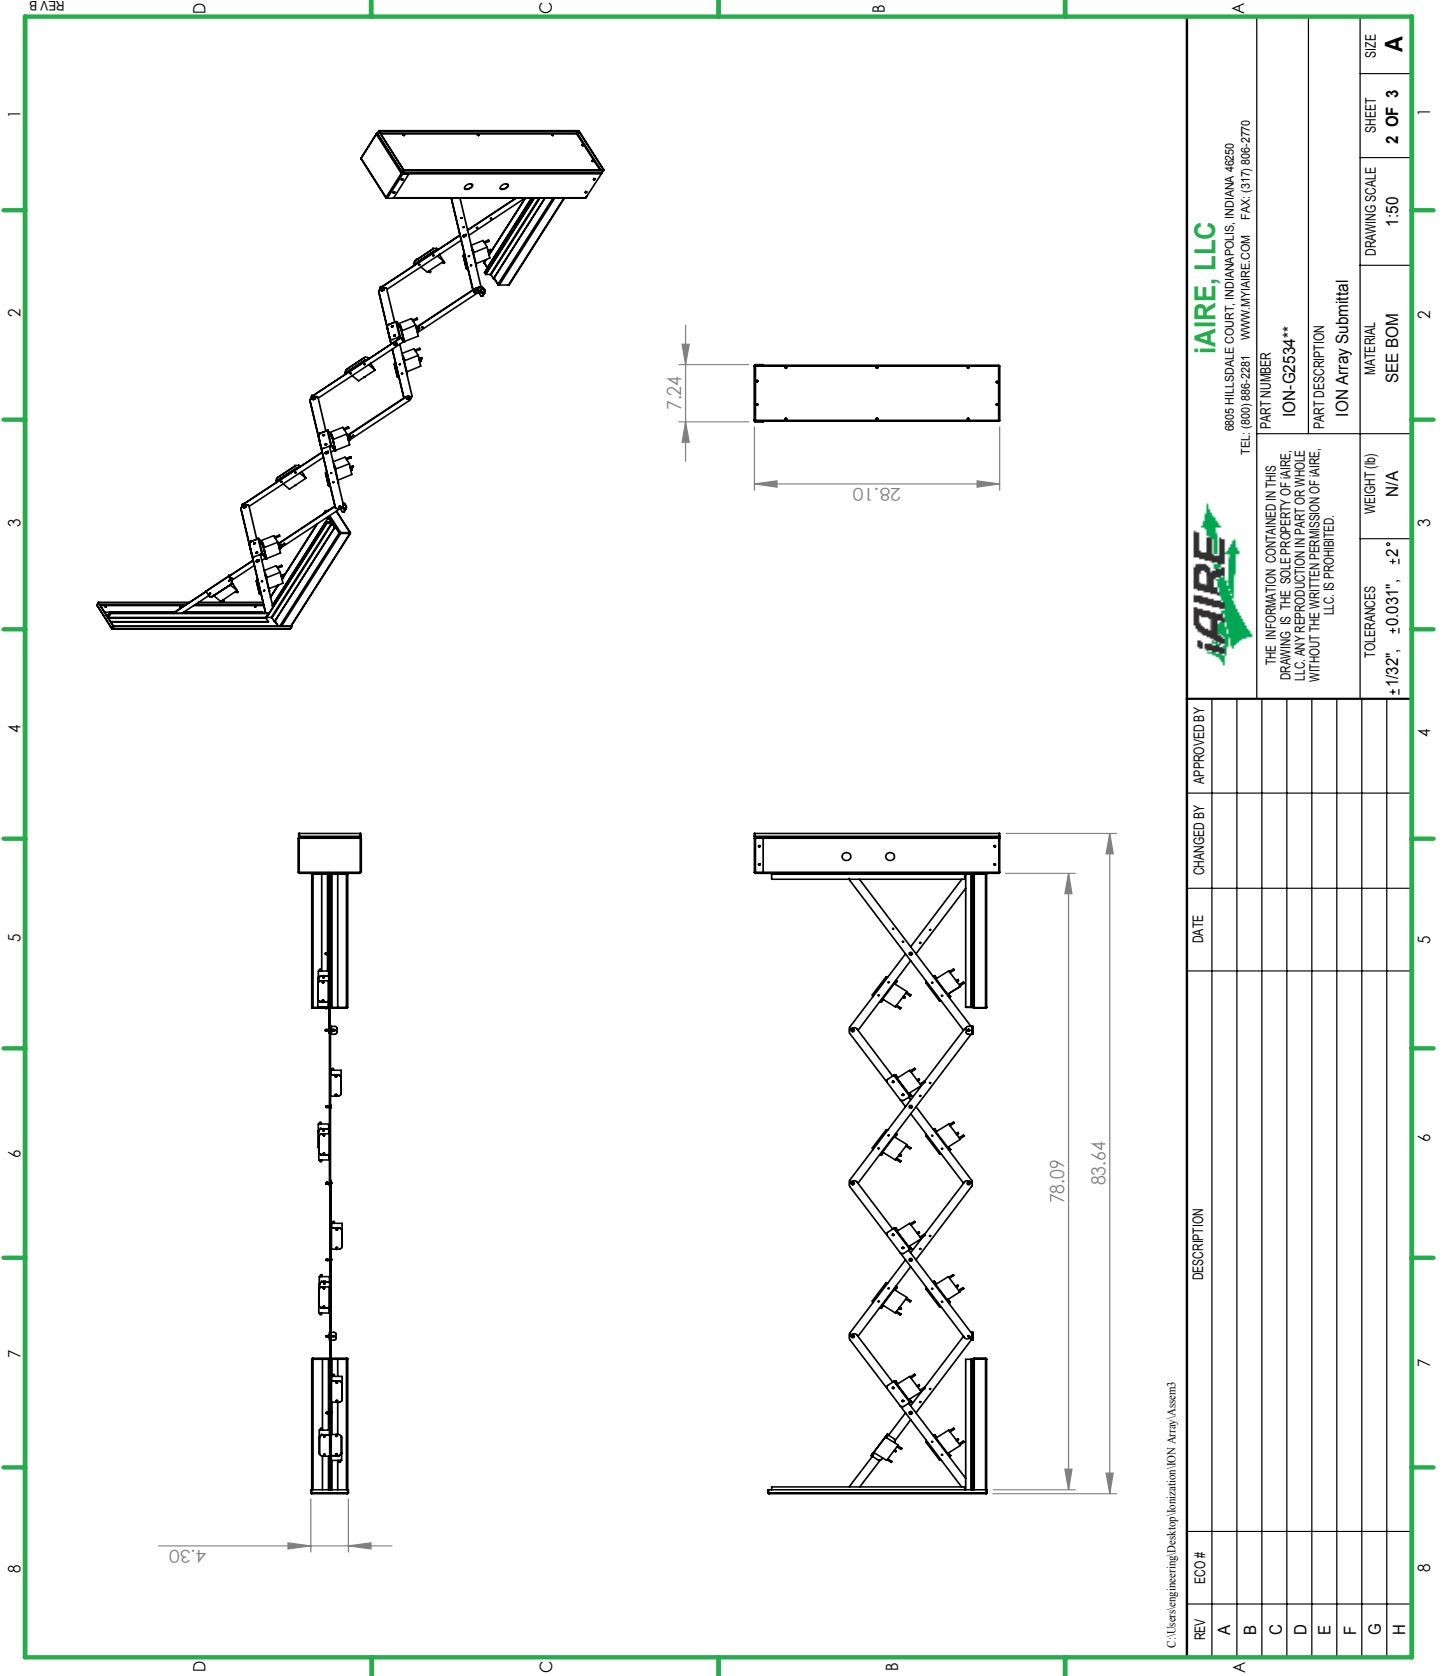

C:\Users\engineering\Desktop\Ionization\ION Array\Assem3

REV	ECO#	DESCRIPTION	DATE	CHANGED BY	APPROVED BY
A					
B					
C					
D					
E					
F					
G					
H					

		iAIRE LLC 8805 HILLSDALE COURT, INDIANAPOLIS, INDIANA 46250 TEL: (607) 886-2281 WWW.IAIRE.COM FAX: (317) 806-2770	
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF IAIRE, LLC. ANY REPRODUCTION IN PART OR WHOLE WITHOUT THE WRITTEN PERMISSION OF IAIRE, LLC IS PROHIBITED.		PART NUMBER ION-C2534**	PART DESCRIPTION ION Array Submittal
TOLERANCES $\pm 1/32"$, $\pm 0.031"$, $\pm 2^\circ$	WEIGHT (lb) N/A	MATERIAL SEE BOM	DRAWING SCALE 1:50
		SHEET 2 OF 3	SIZE A

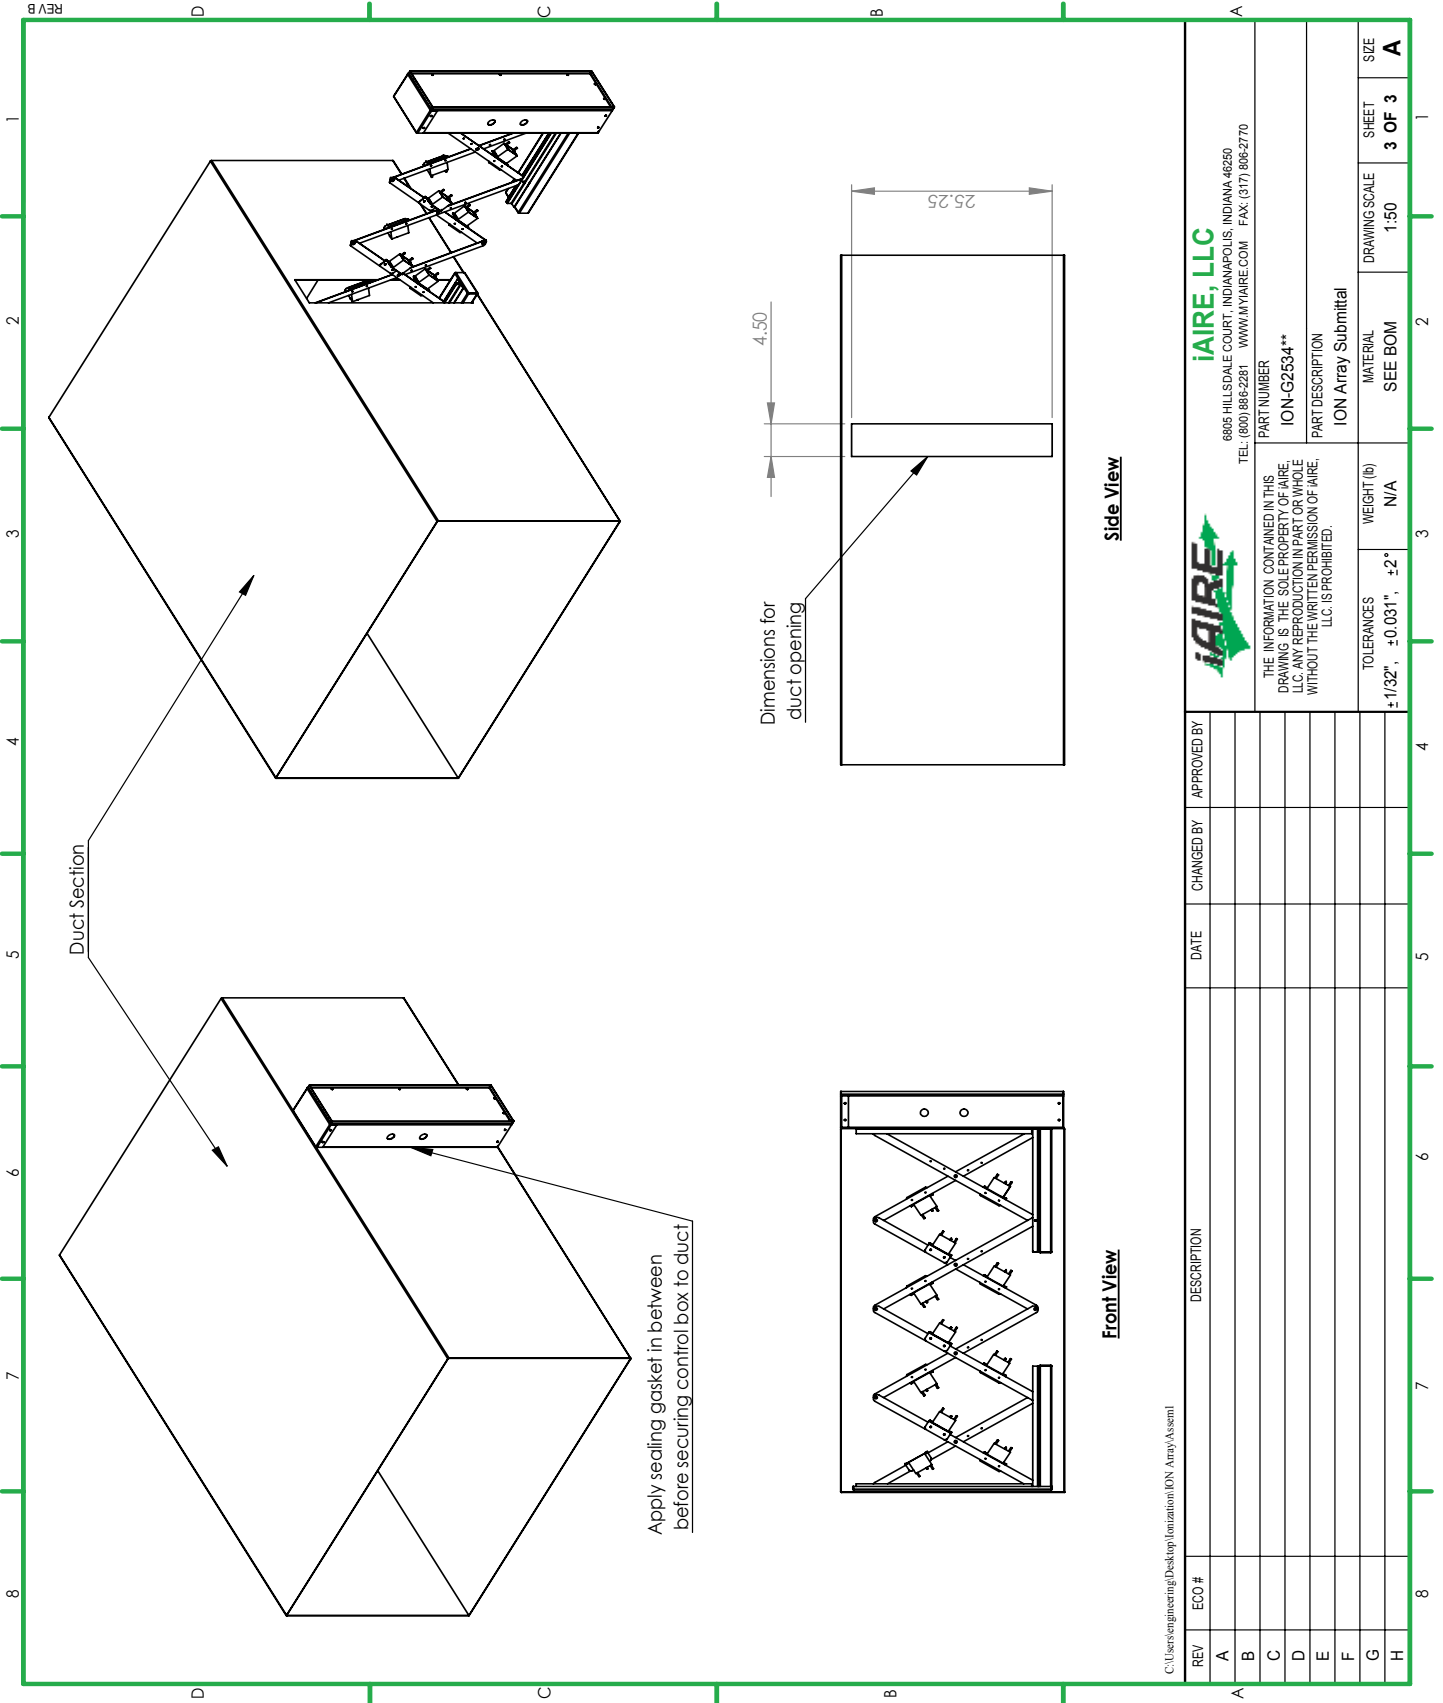


REV	ECO #	DESCRIPTION	DATE	CHANGED BY	APPROVED BY
A					
B					
C					
D					
E					
F					
G					
H					

		iAIRE, LLC 6805 HILLSDALE COURT, INDIANAPOLIS, INDIANA 46250 TEL: (800) 886-2281 WWW.IAIRE.COM FAX: (317) 886-2770	
PART NUMBER ION-G2634**		PART DESCRIPTION ION Array Submittal	
TOLERANCES $\pm 1/32"$, $\pm 0.031"$, $\pm 2^\circ$	WEIGHT (lb) N/A	MATERIAL SEE BOM	DRAWING SCALE 1:50
		SHEET 3 OF 3	SIZE A

C:\Users\engineering\Desktop\Iomization\ION Array\Assem1


ION Rod Array Submittal Info

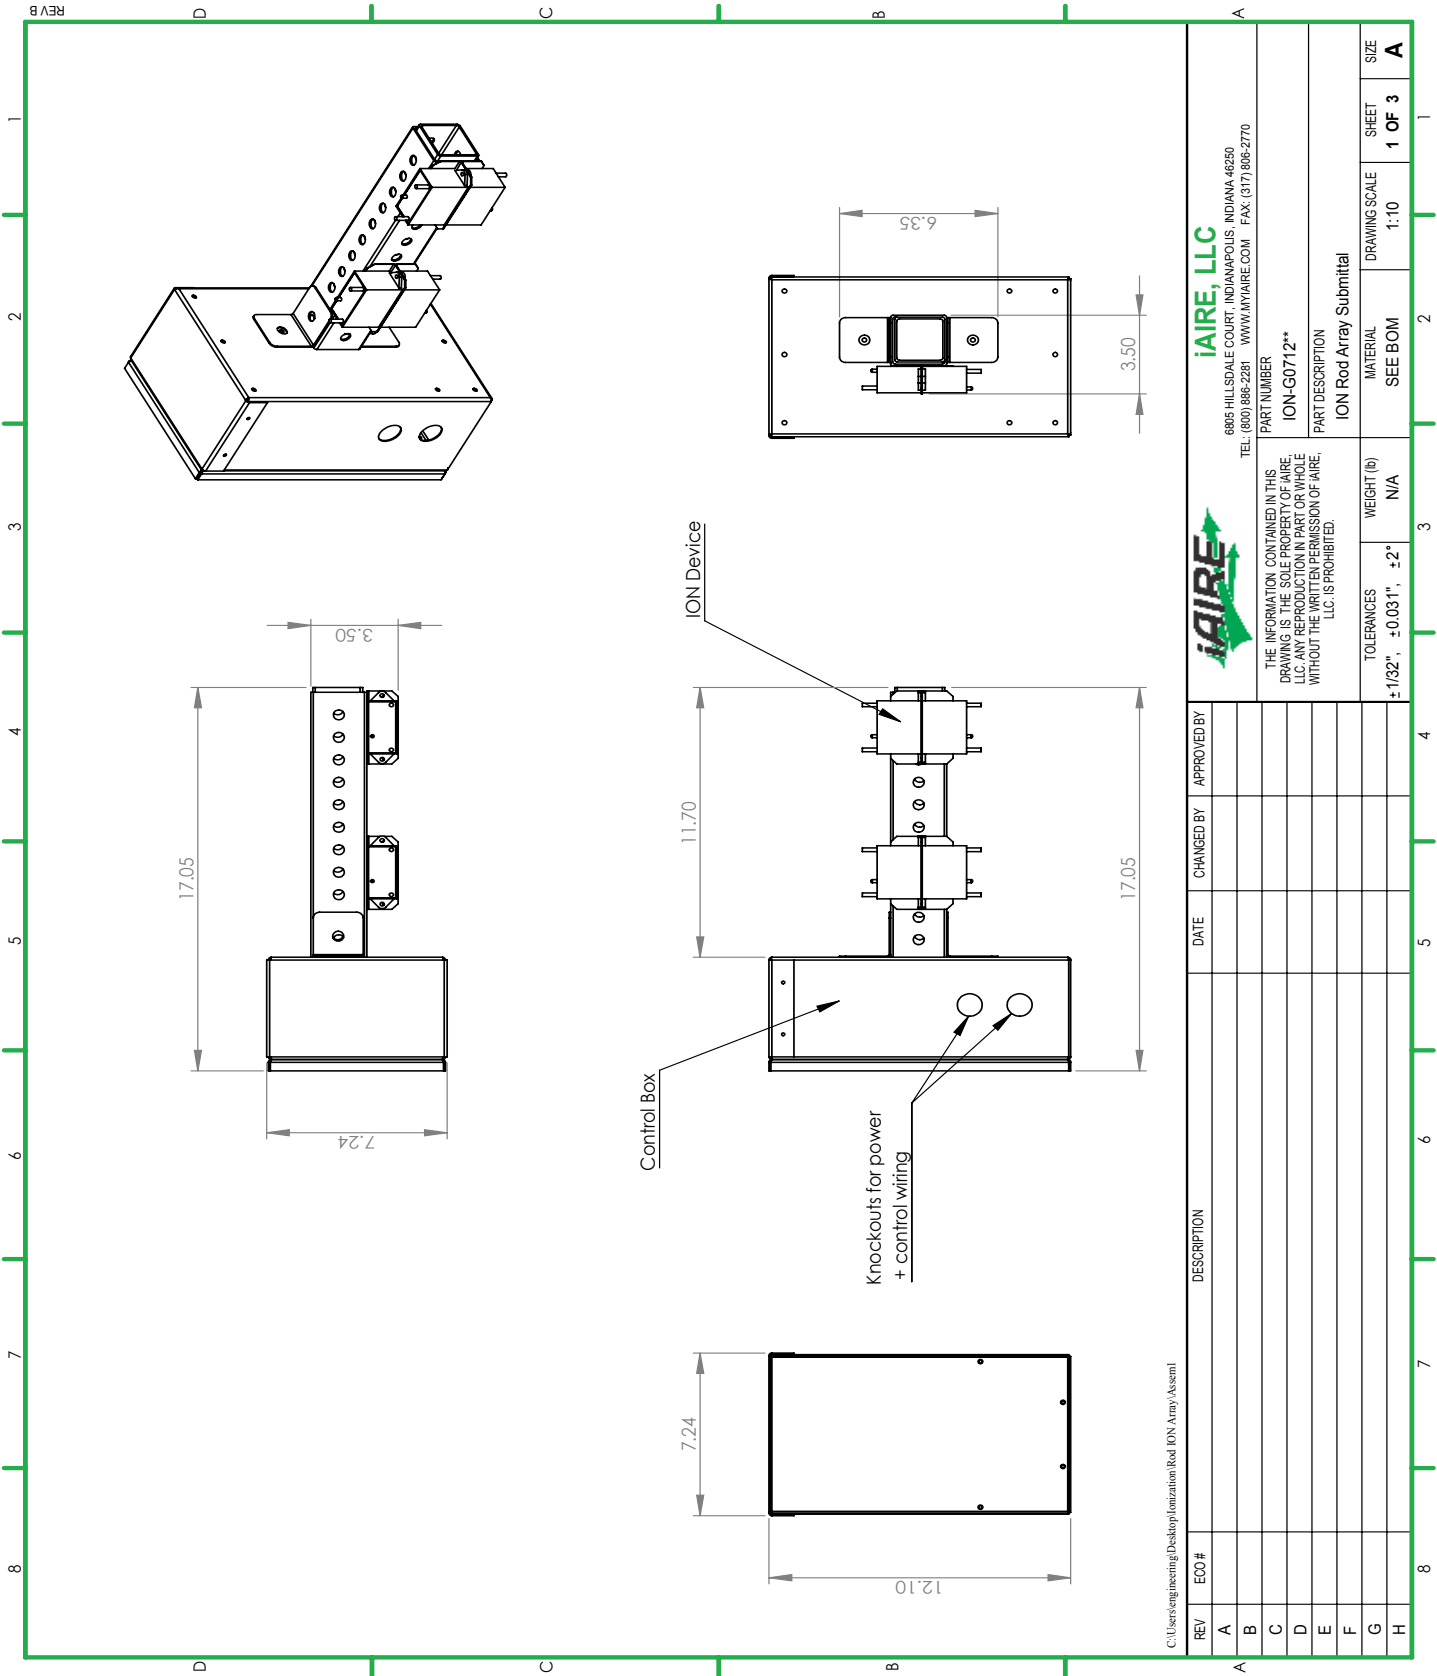

REV	ECO #	DESCRIPTION	DATE	CHANGED BY	APPROVED BY
A					
B					
C					
D					
E					
F					
G					
H					


		iAIRE, LLC 6805 HILLSDALE COURT, INDIANAPOLIS, INDIANA 46250 TEL: (800) 886-2281 WWW.IAIRE.COM FAX: (317) 806-2770	
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF IAIRE, LLC. ANY REPRODUCTION IN PART OR WHOLE WITHOUT THE WRITTEN PERMISSION OF IAIRE, LLC IS PROHIBITED.		PART NUMBER ION-G0712**	PART DESCRIPTION ION Rod Array Submittal
TOLERANCES $\pm 1/32"$, $\pm 0.031"$, $\pm 2^\circ$	WEIGHT (lb) N/A	MATERIAL SEE BOM	DRAWING SCALE 1:10
		SHEET 1 OF 3	SIZE A

C:\Users\engineering\Desktop\Ionization\Rod Array\Assem1

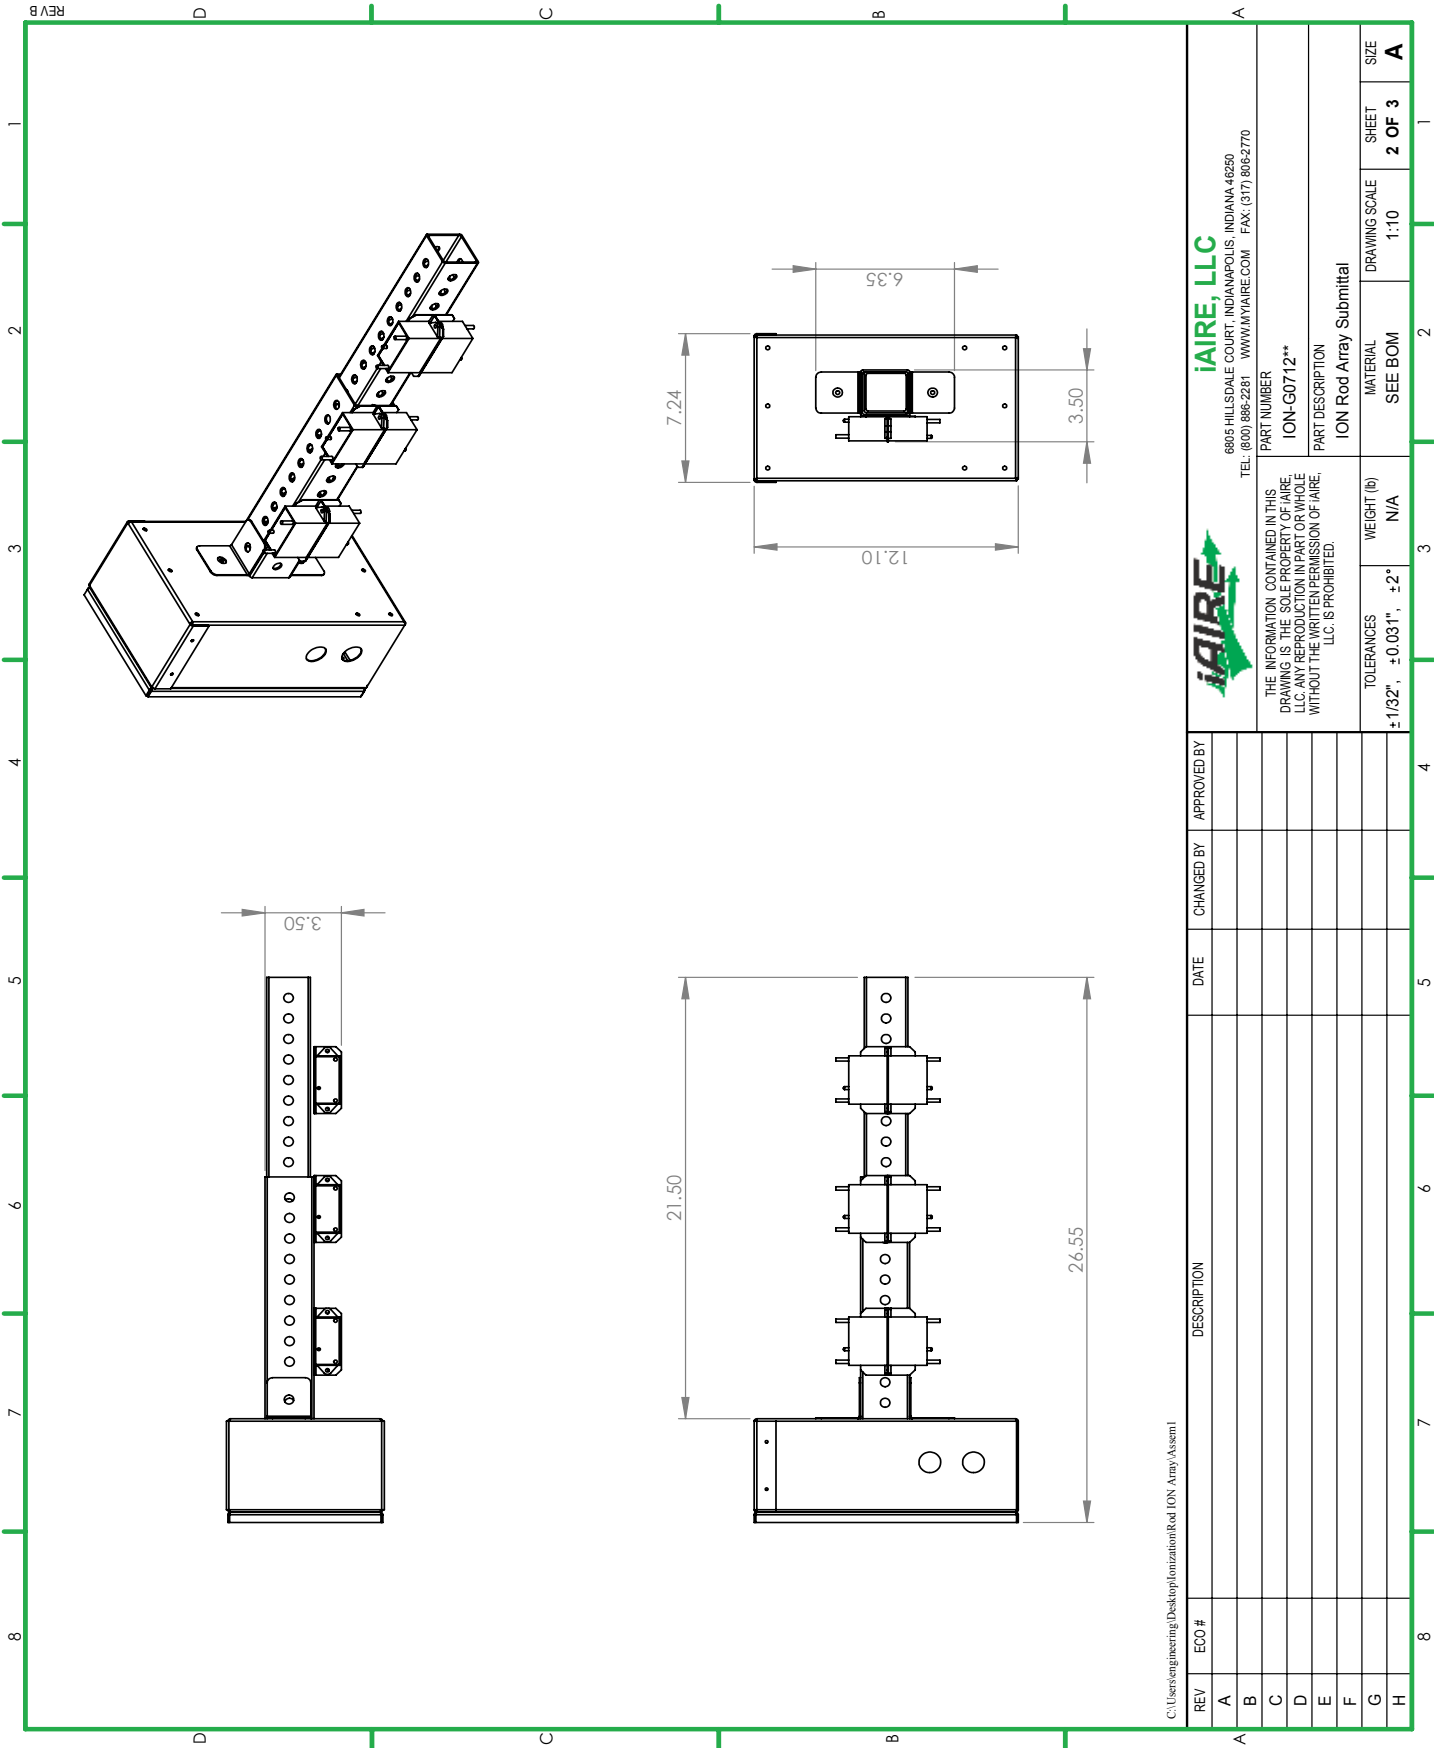

REV	ECO #	DESCRIPTION	DATE	CHANGED BY	APPROVED BY
A					
B					
C					
D					
E					
F					
G					
H					


		iAIRE, LLC 6806 HILLDALE COURT, INDIANAPOLIS, INDIANA 46250 TEL: (800) 886-2281 WWW.IAIRE.COM FAX: (317) 806-2770	
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF IAIRE, LLC. ANY REPRODUCTION IN PART OR WHOLE WITHOUT THE WRITTEN PERMISSION OF IAIRE, LLC, IS PROHIBITED.		PART NUMBER ION-G0712**	DRAWING SCALE 1:10
TOLERANCES ±1/32", ±0.031", ±2°	WEIGHT (lb) N/A	MATERIAL SEE BOM	SHEET 2 OF 3
ION Rod Array Submittal		SIZE A	

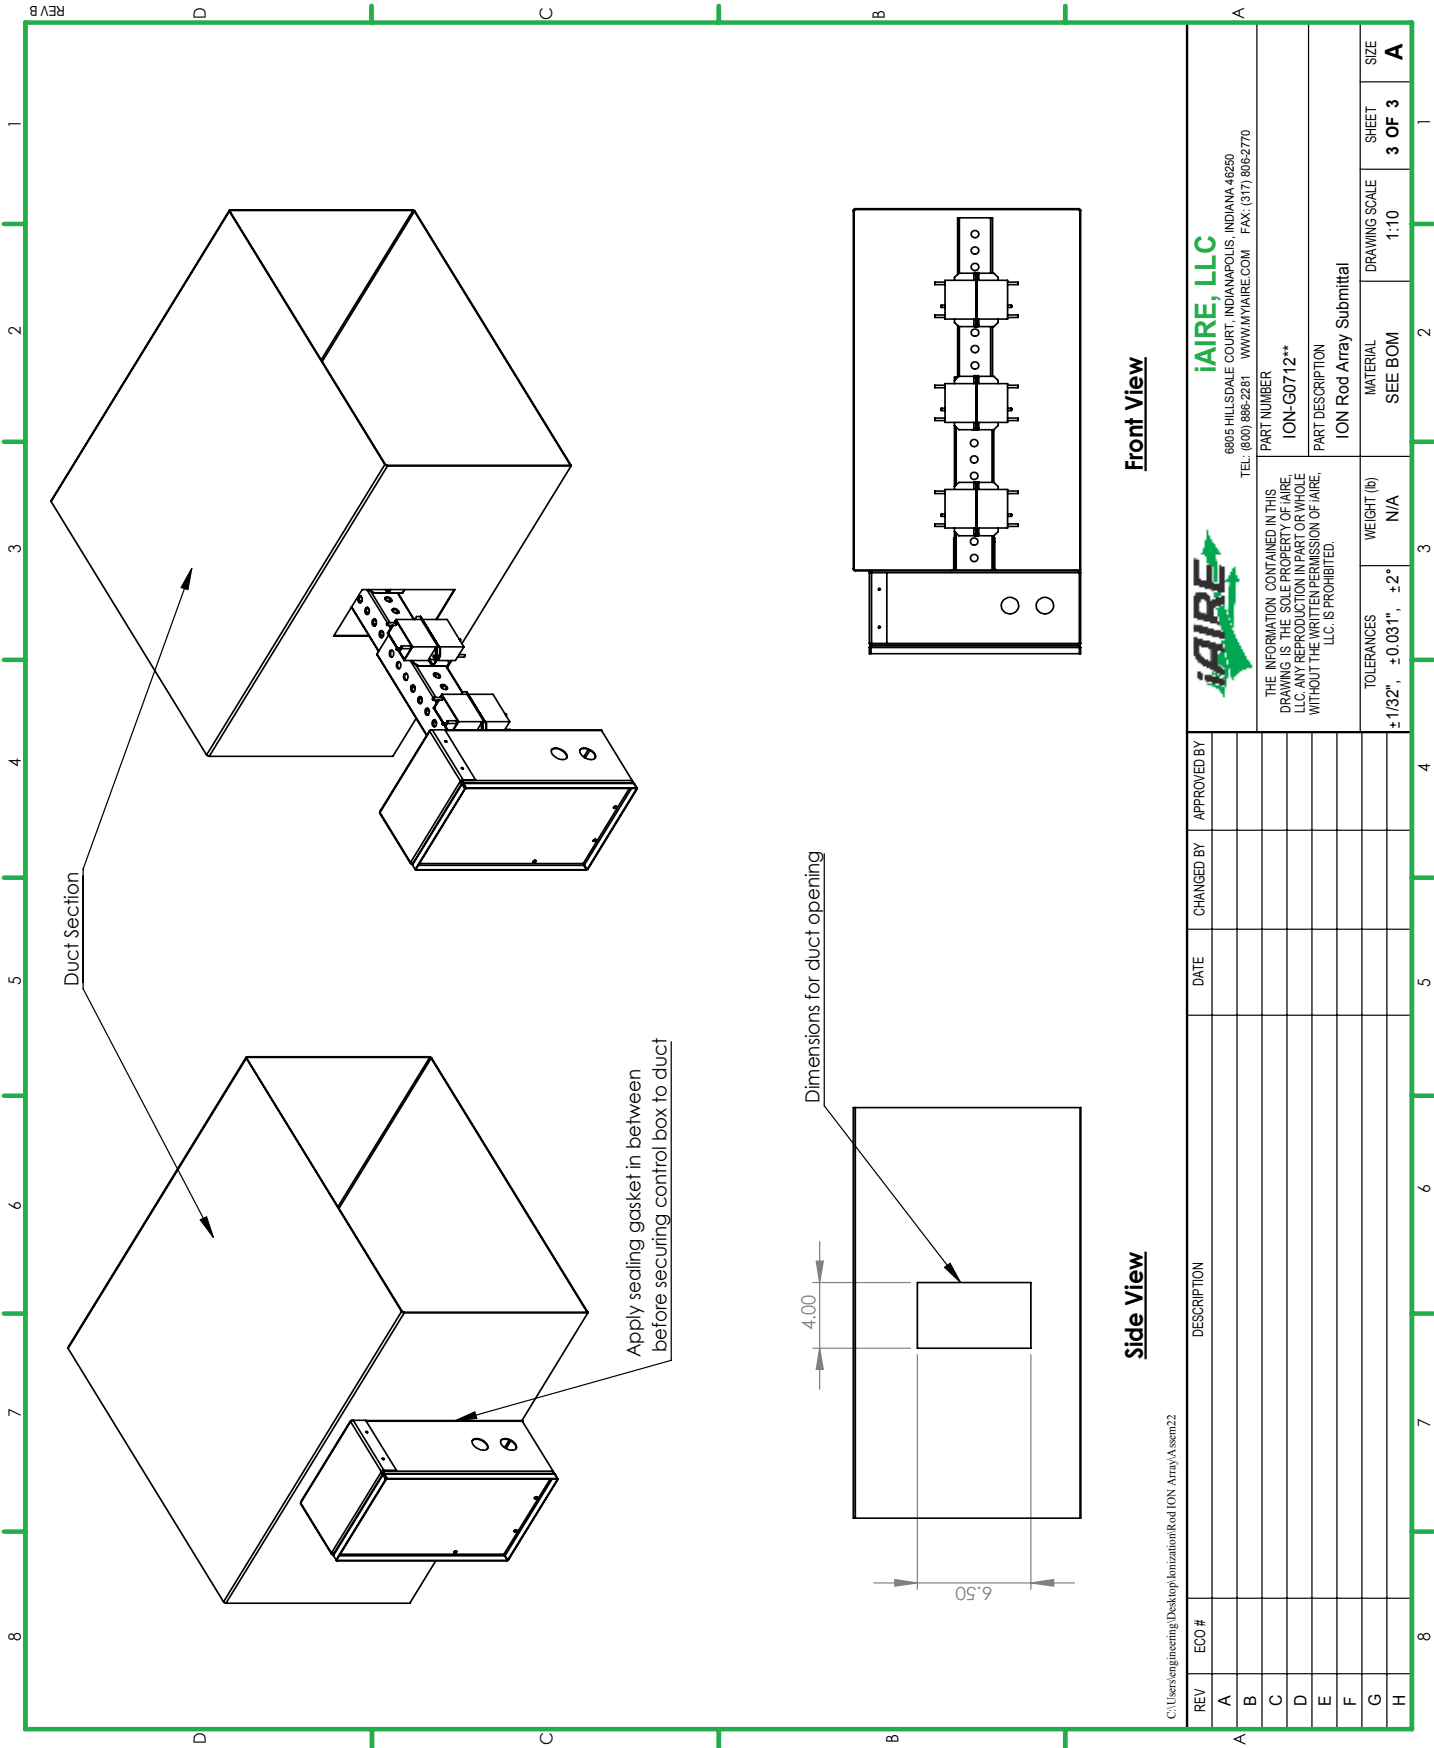

REV	ECO #	DESCRIPTION	DATE	CHANGED BY	APPROVED BY
A					
B					
C					
D					
E					
F					
G					
H					

		iAIRE, LLC 6805 HILLSDALE COURT, INDIANAPOLIS, INDIANA 46250 TEL: (800) 886-2281 · WWW.IAIRE.COM · FAX: (317) 806-2770	
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF IAIRE, LLC. ANY REPRODUCTION IN PART OR WHOLE WITHOUT THE WRITTEN PERMISSION OF IAIRE, LLC, IS PROHIBITED.		PART NUMBER ION-G0712**	SHEET 3 OF 3
TOLERANCES $\pm 1/32"$, $\pm 0.031"$, $\pm 2^\circ$	WEIGHT (lb) N/A	MATERIAL SEE BOM	DRAWING SCALE 1:10
ION Rod Array Submittal		PART DESCRIPTION ION Rod Array Submittal	SIZE A

Ionization Array Wiring

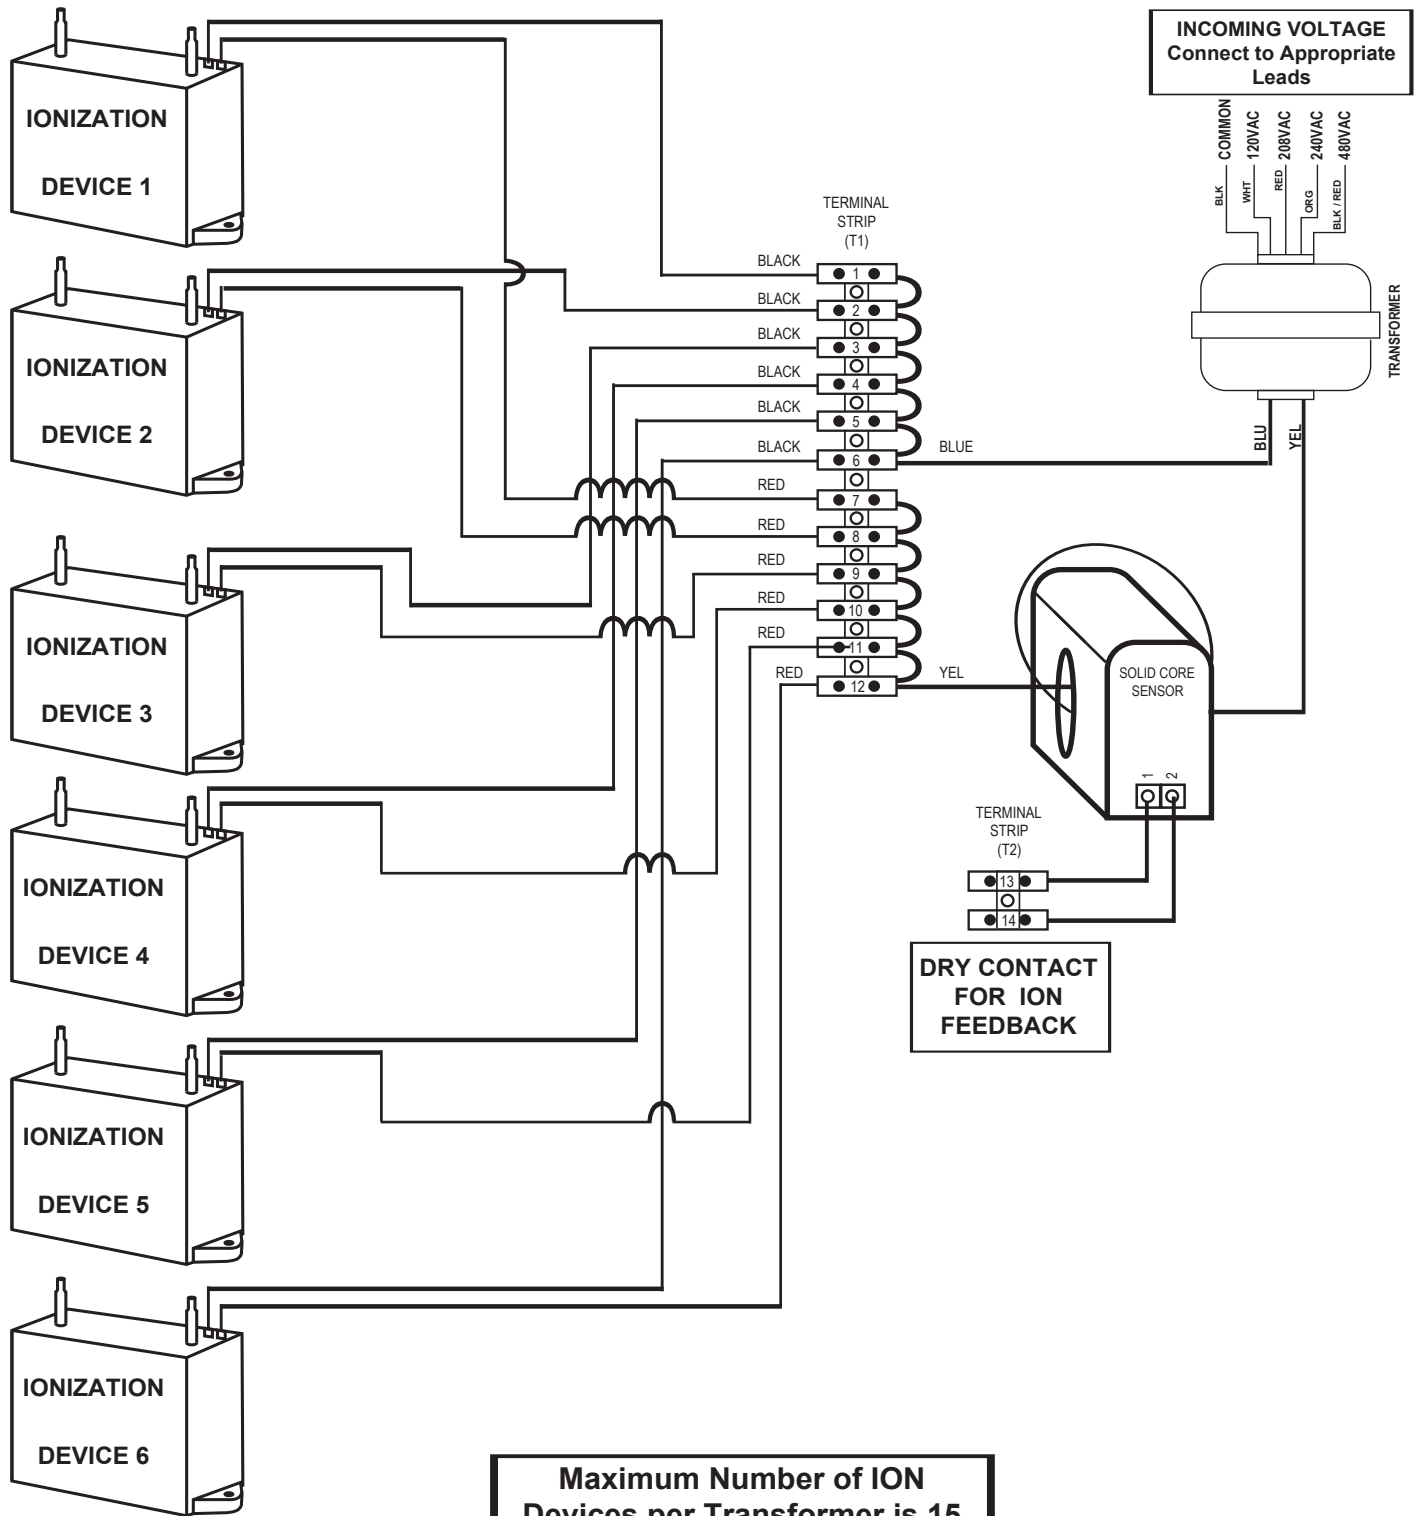

Maximum Number of ION Devices per Transformer is 15 Devices. Expand on Terminal Strip 1 (TS1) for Additional Devices