

# TRANE PREC35 VERTICAL ECONOMIZERS I/O/M MANUAL

# **Table of Contents**

Trane Economizer Description	3
PREC35 Vertical Submittal	
PREC35 Vertical Install	
Additional Install Notes	7

For information on iAIRE's Economizer Controls Package, please refer to IOM-0014

# **Trane Economizer Description**

PLEASE NOTE: Our economizer is a low leak, field installed economizer with the iAIRE patented controls packages and actuator, allowing you to reduce the amount of outside air needed from your rooftop HVAC system by up to 2/3 and will improve indoor air quality.

This reduction in system operation creates on-going utility savings. Payback on capital equipment costs with an iAIRE economizer can be realized in fewer than three years. These packages are designed to work directly on existing rooftop HVAC systems.

These economizers are all low leak and meet the IECC 2015 requirement and are Title 24 compliant by meeting section 120.2(i) for the required controls and the efficiency requirements in 140.4(e).

## **Unit to RTU Conversion**

PREC35

TSC 036G-060G, Y SC 036G -060G, THC 036G, YHC 036G, TSC 036H-060H, YSC 036H-060H, THC 036H, Y HC 036H, TZC 036F, W HC 036H, WSC 036H-48H, YZC 036F, GW SC 036H-048H

## **Part Number**

## type

**EC - ECONOMIZER** 

26	6075
712	100
1525	125
3050	150

Controls Only

#### CHAS12 CHAS34 CHAS5

CHAS69 Carrier

#### A-ROX **B-BOX** C-BOX

D-BOX E-BOX F-BOX

unit/ton (1)

#### FND35 PREC810 PACK13 PREC35 PREC48 PREC610

VOY12 VOY12HE VOY1525HE

#### SCS12 SCS34 SCSHE12 SCSHE34 SCL12

0 - ECON ONLY

A - IAQ

D - DCV

AFF

LXS

LXL

SCLHE12 SCLHE34 **PRED PREDS** SL SII

SLU

SCL 34

York

controls (4)

**B-IAQ (NO IONIZATION)** 

## configuration (2)

0 - NO ECON C - CONVERTIBLE

H - HORIZONTAL V - VERTICAL

## power exhaust (5)

0 - NO POWER EXHAUST A - 208/230V 1Φ FIXED PE В - 208/230V 3Ф FIXED PE

С - 460V 3Ф FIXED PE

#### actuator (3)

Lennox

0 - NO ACTUATOR

A - 20 IN-LB B - 62 IN-LB

C - 160 IN-LB

## options (6)

0 - NONE

**B - HUMIDITY** 

C - BACNET D - BLDG PRESSURE\*


R - RTU OPEN

U - ULTRA LOW LEAK

Note: By adding option "D" any powered exhaust will be modulating.

# iAIRE LLC | 2100 Consulate Drive Suite 102, Orlando, FL 32837

# **PREC35 Vertical Submittal**

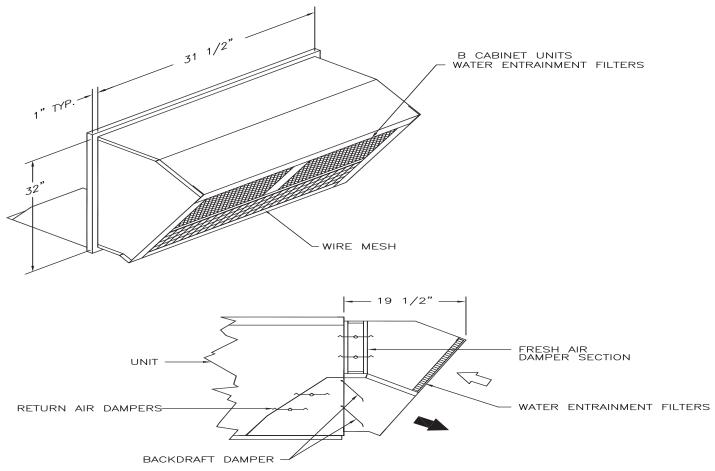

#### **Electrical Data**

PART#	WEIGHT	PART	AMPS	PART	AMPS	TOTAL
EC-PREC35-VBA0-*	101 lbs.	ACTUATOR	.29A	CONTROLS	.27A	.56A

*OPTIONS
0 - No Options
B - Humidity/Enthalpic
C - BACNet

#### **Features**

- · iAIRE Patented Controls Scheme Included
- · Low Leak Damper Included
- · VOC, CO2 and Ionization included
- · Heavy Gauge Galvanized Steel Construction
- · American Sterling Grey Paint Finish
- · One Piece Assembly
- · Gear Driven Dampers
- · Uses HVAC Unit Filter Access Door
- · Capable of Relieving up to 100% of the Outside Air Intake

Economizers with Indoor Air Quality control are Title 24 compliant by meeting section 120.2(i) for the required controls and the efficiency requirements in 140.4(e). They also meet California ozone emissions requirements to be CARB certified.

iAIRE, LLC | 2100 Consulate Drive, Suite 102, Orlando, FL 32837 www.myultrapure.com | Toll Free 844-348-9168

PD 09/15/2021 - v 1.00


# **PREC35 - Vertical Install**


# DOWN DISCHARGE ECONOMIZER INSTALLATION INSTRUCTIONS

- 1 REMOVE RETURN AIR COMPARTMENT PANEL FROM BACK OF HVAC UNIT. (SEE DETAIL #1)
- 2 REMOVE SCREWS ON BACK OF HVAC UNIT HOLDING TOP OF HVAC UNIT DOWN. ALSO REMOVE SCREWS ABOUT HALF-WAY DOWN BOTH SIDES OF HVAC UNIT TOP. (SEE DETAIL #1)
- 3 LIFT TOP OF THE HVAC UNIT AND PROP UP WITH SUPPORTS, 2" SPACING REQUIRED. (SEE DETAIL #2)
- 4 WHEN USING THE BELIMO ACTUATOR OPTION, CONSULT CONTROLS CONTRACTOR REGARDING THE ECONOMIZER WIRING REQUIREMENTS.
- 5 SLIDE ECONOMIZER ASSEMBLY INTO THE HVAC UNIT. MAKE SURE THE LEFT AND RIGHT SIDE FLANGES OF THE ECONOMIZER SLIDE INTO THE SIDE GROVES OF THE HVAC UNIT.

  (SEE DETAIL DRAWING #2 & #3)
- 6 REMOVE SUPPORTS USED TO PROP THE TOP OF THE HVAC UNIT. SUPPORTS USED FROM STEP #3.

  NOTE: THE TOP OF HVAC UNIT HOOKS OVER THE TOP FLANGE OF ECONOMIZER (SEE DETAIL #4)
- 7 SECURE TOP OF THE ECONOMIZER
  TO THE HVAC UNIT BY USING SCREWS
  REMOVED IN STEP #2. ALSO SCREW
  ALONG THE SIDE FLANGES OF THE
  ECONOMIZER USING #12 X 1 SCREWS
  PROVIDED WITH ECONOMIZER PACKAGE.
  (SEE DETAIL #5)

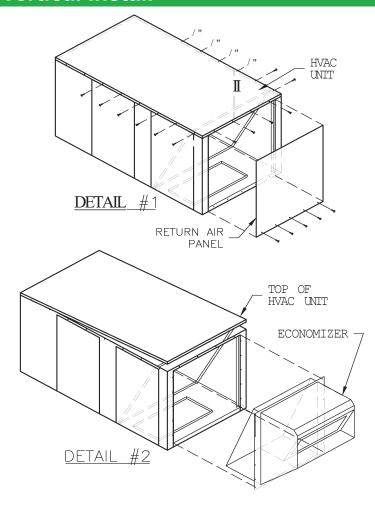

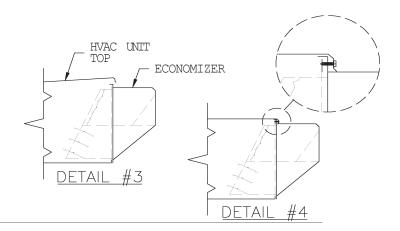

DETAIL

# PREC35 - Vertical Install (cont'd)

# DOWN DISCHARGE ECONOMIZER INSTALLATION INSTRUCTIONS

- 8 REPLACE ALL SCREWS ALONG THE SIDES OF THE TOP OF THE HVAC UNIT, REMOVED N STEP #2. (SEE DETAIL #5)
- 9 REMOVE RETURN AIR COMPARTMENT PANEL LOCATED ON THE RIGHT SIDE OF HVAC UNIT.

  (SEE DETAIL #6)

10 - PLUG ECONOMIZER HARNESS INTO THE HVAC UNIT ECONOMIZER HARNESS.
NOTE: HARNESS WILL BE INSIDE UPPER CORNER OF RETURN AIR COMPARTMENT.
(SEE DETAIL #7)

JADE MIXED AIR

SENSOR


STANDARD MIXED AIR SENSOR \

11 - REMOVE THE DISCHARGE AIR SENSOR
FROM THE SHIPPING LOCATION BEHIND THE WATER
ENTRAINMENT FILTER ON THE ECONOMIZER AND
MOUNT IT N THE HVAC UNIT SUPPLY FAN
COMPARTMENT NEXT TO THE FAN INLET.

HVAC UNIT

SUPPLY BLOWER

DETAIL #11

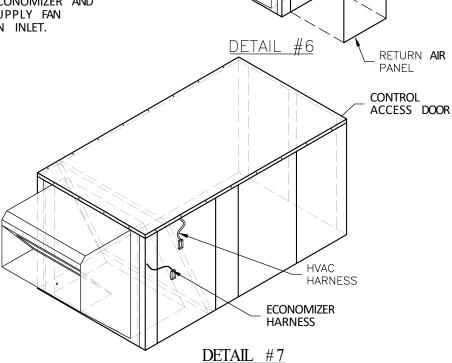

# **Trane Economizer Install Notes**

## **Additional Notes**

- 1. Power Supply. Provide disconnect means and overload protection as required.
- 2. Motor Spring-Returns closed when unit is not running.
- 3. Ensure that equipment transformer is sized to handle the extra load of the economizer and actuator.
- 4. When using a heat with defrost feedback, add an isolation relay between O and C. (Field provided and installed).