

Product Data

EC-PREC48-***0-* | Trane Economizer

Description

PLEASE NOTE: Our economizer is a low leak, field installed economizer with the iAIRE patented controls packages and actuator, allowing you to reduce the amount of outside air needed from your rooftop HVAC system by up to 2/3 and will improve indoor air quality.

This reduction in system operation creates on-going utility savings. Payback on capital equipment costs with an iAIRE economizer can be realized in fewer than three years. These packages are designed to work directly on existing rooftop HVAC systems.


These economizers are all low leak and meet the IECC 2015 requirement and are Title 24 compliant by meeting section 120.2(i) for the required controls and the efficiency requirements in 140.4(e).

Unit to RTU Conversion		
PREC48	THC 048G-060G, T WSC 060H-072H,	TSC 060H-090H, YSC 060G-090G, YSC 060H-090H, THC 048H-060H, YHC 048G-060G , YSC 048H-060H, TZC 048E-60E, 048F-60F, YZC 048E-60E, 048F-60F, C 060-072H, GWSC 060H, GERE 072
Part Number		
EC - ECONO	26 6075	- 2 3 4 5 - 6 <u>unit/ton (1)</u> CHAS12 CHAS34 CHAS5 CHAS69 Carrier A-BOX C-BOX C-BOX C-BOX E-BOX Lennox A-BOX C-BOX E-BOX Lennox A-BOX C-BOX C-BOX E-BOX Lennox A-BOX C-B
0 - NC C - CC H - HC	Uration (2) D ECON ONVERTIBLE ORIZONTAL ERTICAL	actuator (3)controls (4)0 - NO ACTUATOR A - 20 IN-LB0 - ECON ONLY A - IAQB - 62 IN-LB C - 160 IN-LBB - IAQ (NO IONIZATION) D - DCV
0 - NO POWE A - 208/230V 1 B - 208/230V 3 C - 460V 3Φ F	1Φ FIXED PE 3Φ FIXED PE	Options (6) 0 - NONE B - HUMIDITY C - BACNET D - BLDG PRESSURE* R - RTU OPEN U - ULTRA LOW LEAK Note: By adding option "D" any



Product Data

EC - PREC48 - HBA0 - * | Trane Economizer

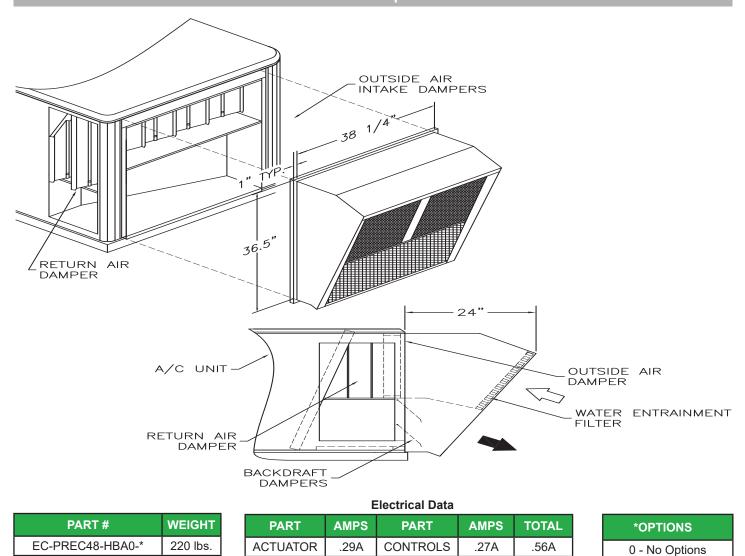

Features

- · iAIRE Patented Controls Scheme Included
- · Low Leak Damper Included
- · VOC, CO2 and Ionization included
- · Heavy Gauge Galvanized Steel Construction
- · American Sterling Grey Paint Finish
- · One Piece Assembly
- · Gear Driven Dampers
- · Uses HVAC Unit Filter Access Door
- · Capable of Relieving up to 100% of the Outside Air Intake

Economizers with Indoor Air Quality control are Title 24 compliant by meeting section 120.2(i) for the required controls and the efficiency requirements in 140.4(e). They also meet California ozone emissions requirements to be CARB certified.

B - Humidity/Enthalpic C - BACNet